


-15kV TOF: -9116 v  
 -3.6kV MCP: -2578 v  
 -2.4kV MCP: -1589 v  
 Input Cur: 302 ma  
 RPA max: 237 v  
 Mirror max: 238 v

Mon Sep 25 10:49:00 2006

## TIDE Direct Events

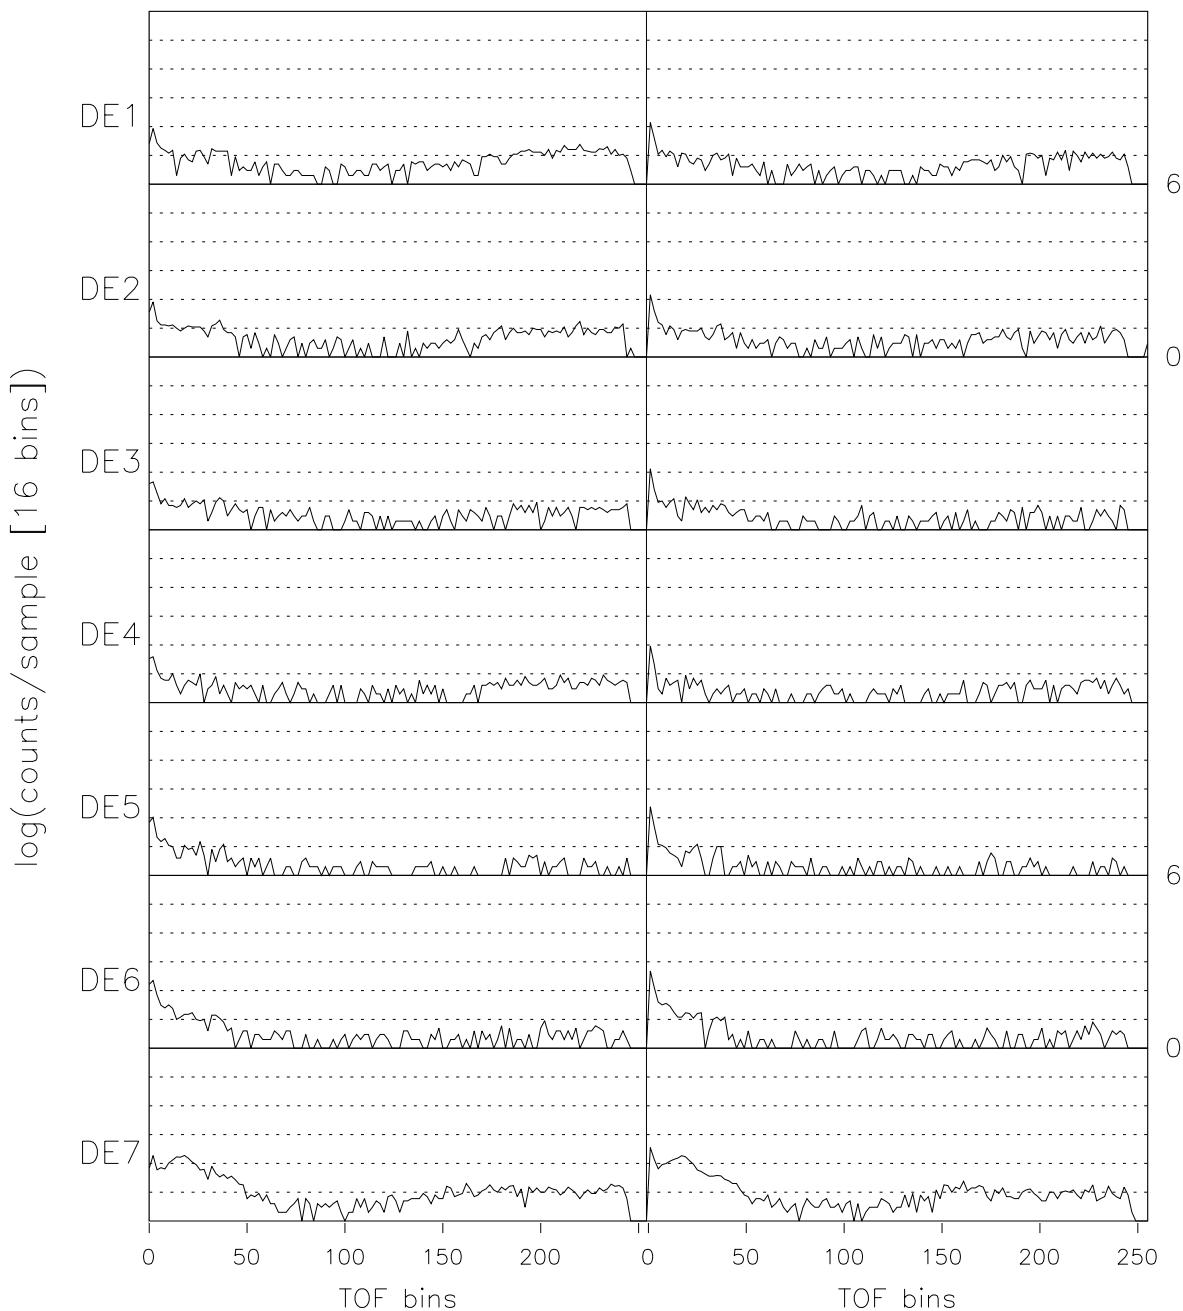

reported: 09-03-96 16:10:16 UT

reported: 09-03-96 16:13:28 UT

file: /export/data/tide/nrt/96090301.dat

-15kV TOF: -9116 v

-3.6kV MCP: -2782 v

-2.4kV MCP: -1579 v

Input Cur: 304 ma

RPA max: 237 v

Mirror max: 238 v